

EPS

23/11/15

QP Code: 5307

(3 Hours)

[Total Marks: 80

N.B.: (1) Question no. 1 is compulsory

- (2) Attempt any three questions from remaining questions.
- (3) Assume suitable data if necessary.
- 1. (a) Explain transposition of power line

account effect of ground.


20

- (b) Give classification of tower based on angle of deviation.
- (c) Compare AC and DC supply System.
- (d) Why transmission systems are operated at high voltage.
- 2. (a) Derive an expression for inductance of 1ϕ , 2 wire line with solid conductors. Write 10
 - assumptions.

 (b) Derive an expression for capacitance per phase per km of a 1 h line taking into
 - 10
- 3. (a) Prove that per unit impedance of transformer can be made same referred to both the windings by selecting proper voltage based on either side.

 - (b) Fig. Shows a power systems. The ratings of generators and transformers are
 - Generator $1 \rightarrow 25 \text{ MVA}, 6.6 \text{ kV}, \text{ Xd} = j \cdot 0.2 \text{ pu}$
 - Generator $2 \rightarrow 20 \text{ MVA}, 6.6 \text{ kV}, \text{ Xd} = j 0.15 \text{ pu}$ Generator $3 \rightarrow 30 \text{ MVA}, 13.2 \text{ kV}, \text{ Xd} = j 0.15 \text{ pu}$
 - Generator $3 \rightarrow 30 \text{ MVA}, 13.2 \text{ kV}, Xd = j 0.15 \text{ pu}$ Transformer $1 \rightarrow 30 \text{ MVA}, 6.6/115 \text{ kV}, X = j 0.1 \text{ pu}$
 - Transformer $2 \rightarrow 15 \text{ MVA}, 6.6 \text{ Al } 15 \text{ kV}, X=j 0.1 \text{ pu}$
 - Transformer 3 \rightarrow 3 Single phase units each rated at 10 MVA, 69/6.9 KV with X=j 0.1 pu.

Draw per unit reactance diagram if line L1 and L2 reactances are 120 Ω and 90 Ω respectively. Select base of 30 MVA, 6.6 kV in generator -1 circuit.

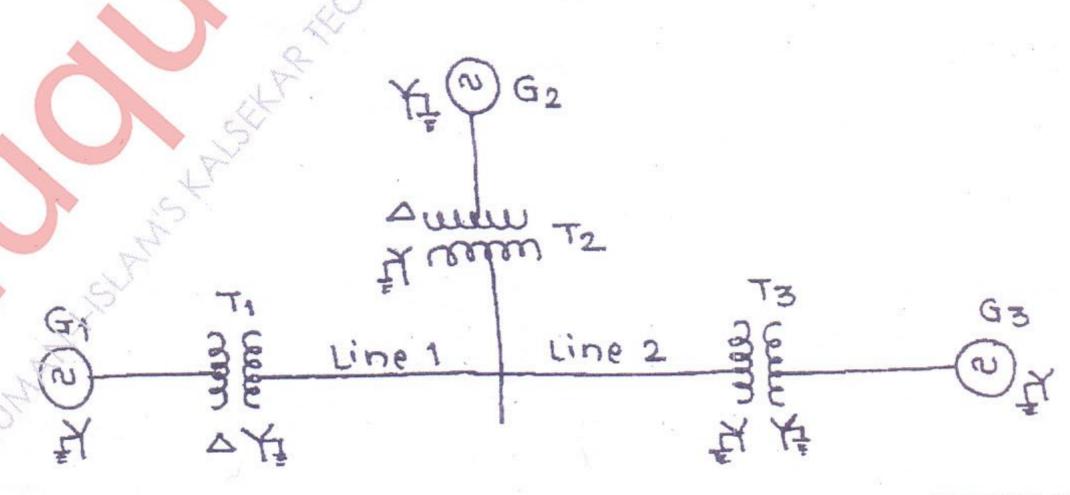

[TURN OVER


MD-Con. 8173-15.

10

10

20

 (a) The 3 φ double circuit line has configuration as shown in fig. The radius of each conductor is 0.9 cm. Find inductance/ ph/km of line.

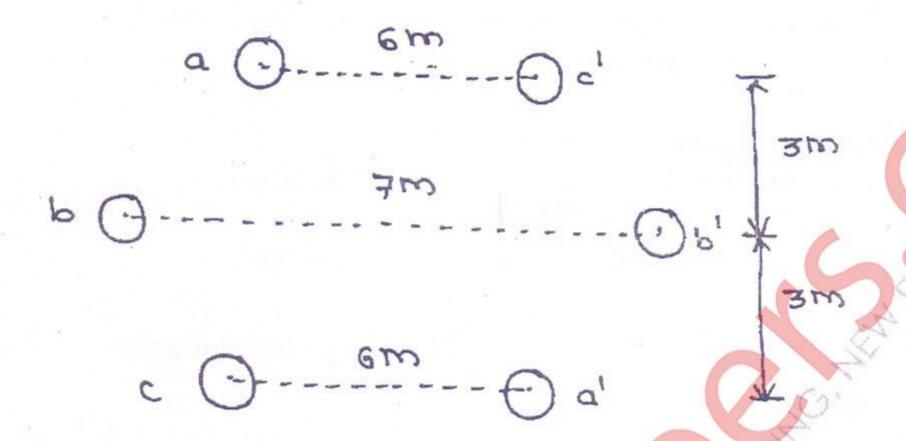

(b) What is string efficiency? Derive expression for string efficiency.

5. (a) What is insulation resistance of cable? Derive expression for insulation resistance of single core cable.

- (b) An overhead line at a river crossing is supported from two towers at heights of 40 m and 90 m above water level. The horizontal distance between towers being 400 m. If maximum allowable tension is 2000 kg. Find clearance between conductor and water at a point midspan between two towers. Weight of conductor is 1 kg/m.
- 6. Attempt any two:-

(a) Explain surge impedance and surge impedance loading.

- (b) What is grading of cable? Explain any one method.
- (c) What is tower footing resistance. Explain measurement of tower footing resistance.